


NOTES:

1. POTTING HOUSING AS SHOWN
2. POTTING TO BE UL 94 V0 OR V1 RATED
3. POTTING TO COVER AND SEAL ALL COMPONENTS
4. WIRING 18AWG UL 1007
5. EACH HARNESS TO BE IN BRAIDED LOOM 125C UL 94 V0 OR V1 RATED
6. NO DEVIATION ALLOWED FROM UL REQUIREMENTS

POTTING HOUSNG BUD HH3466 OR EQUIVALENT  
MUST BE UL 94 V0 OR V1 RATED

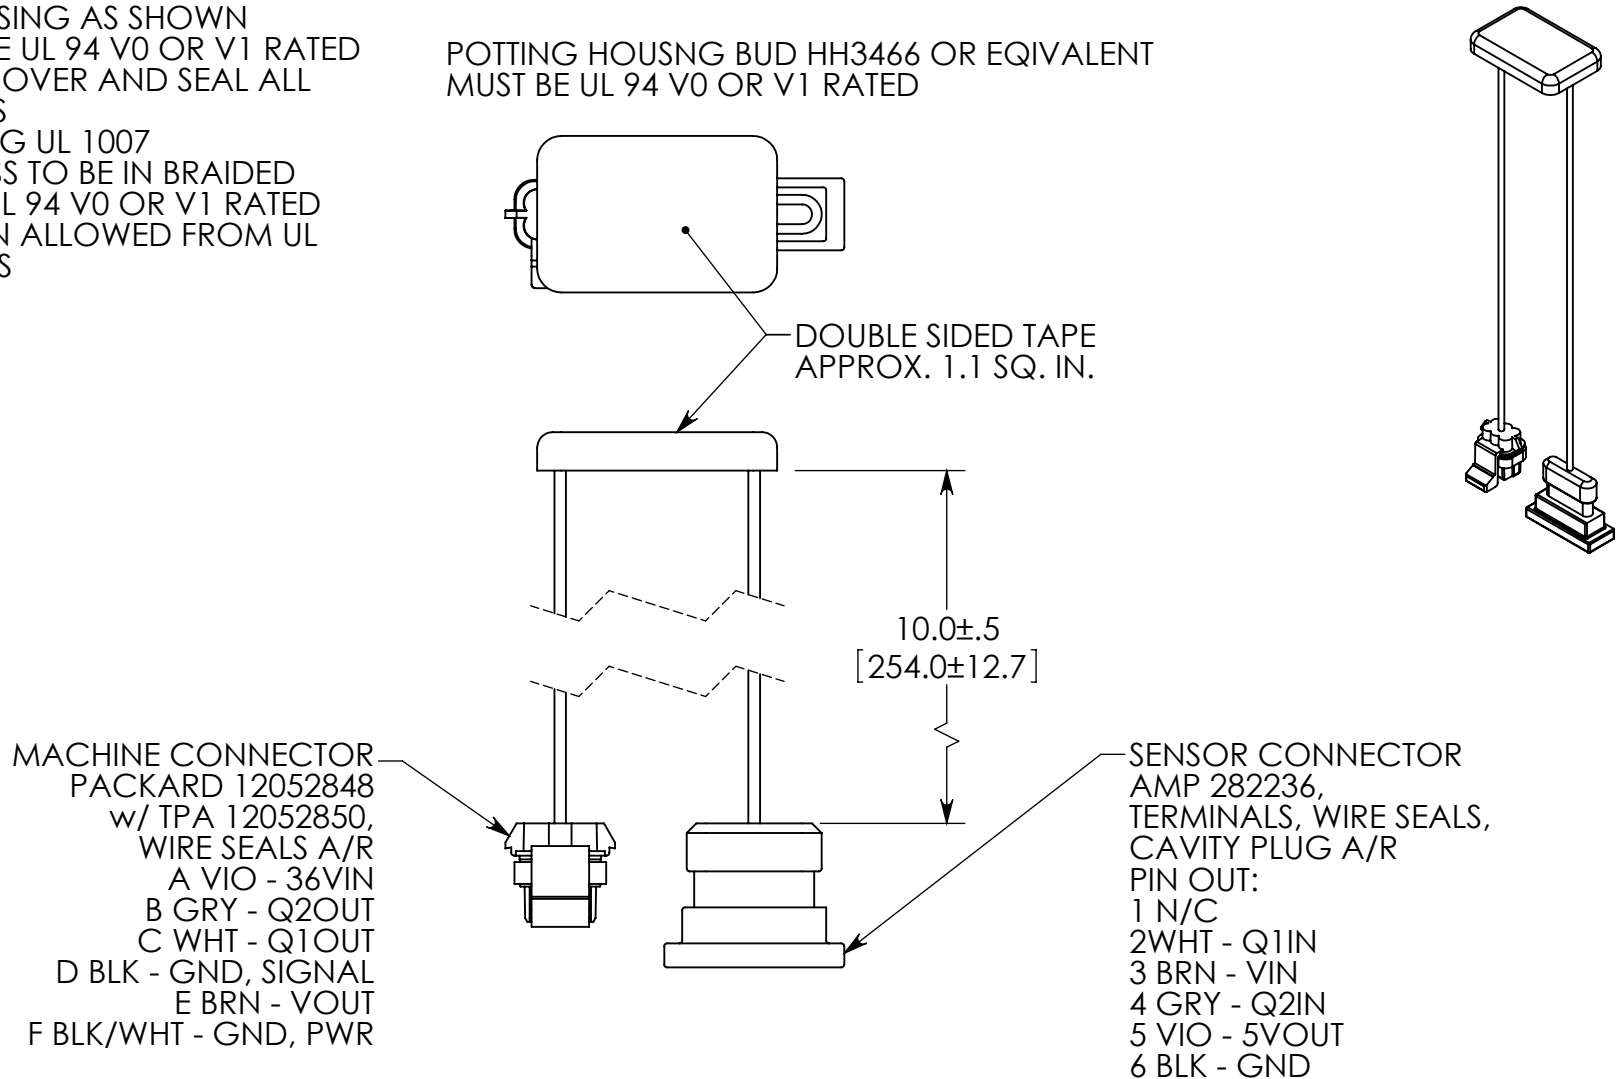

UNITS IN inch [millimeter]

PART #  
**5023**